

State of California
AIR RESOURCES BOARD

Executive Order G-70-194

Certification of Containment Solutions
Rectangular and Cylindrical Hoover Vault Aboveground Tank
Filling/Dispensing Vapor Recovery Systems

WHEREAS, the California Air Resources Board (“the Board” or “CARB”) has established, pursuant to California Health and Safety Code sections 39600, 39601, 39607 and 41954, certification procedures for novel systems designed for the control of Phase I and Phase II gasoline vapor emissions in its “CP-205 Certification Procedure for Vapor Recovery Systems of Novel Facilities” (the “Certification Procedures”) as adopted April 12, 1996, and as last amended March 17, 1999, incorporated by reference into Title 17, California Code of Regulations, Section 94015;

WHEREAS, the Board has established, pursuant to California Health and Safety Code sections 39600, 39601, 39607 and 41954, test procedures for determining the compliance of Phase I and Phase II vapor recovery systems with emission standards in its “Certification and Procedures for Vapor Recovery Systems”, TP-205.1 and TP-205.2, respectively, (“the Test Procedures”) as adopted April 12, 1996, and as last amended March 17, 1999, incorporated by reference into Title 17, California Code of Regulations, Section 94015;

WHEREAS, Containment Solutions has applied for certification of its rectangular and cylindrical Hoover Vault aboveground storage tank vapor recovery system (the “System”) for use in balance Phase I and Phase II operations;

WHEREAS, the system has been evaluated pursuant to the Certification Procedure CP-205, and the Certification Report documents successful performance of the system according to the performance standards, performance specifications and the Test Procedures;

WHEREAS, Section 7 of the Certification Procedures provides that the Executive Officer shall issue an order of certification if he or she determines that the vapor recovery system conforms to all the requirements set forth in Section 1 through 6 of the Certification Procedures;

WHEREAS, on April 15, 1994, in Executive Order G-70-151, the Air Resources Board Executive Officer, pursuant to California Health and Safety Code sections 39515 and 39516, delegated to the Chief, Compliance Division full authority to approve and grant Executive Orders certifying integral Phase I and Phase II aboveground systems in accordance with Health and Safety Code section 41954; and

WHEREAS, I James J. Morgester, Chief of the Compliance Division of the California Air Resources Board, have determined that the Containment Solutions rectangular and cylindrical aboveground storage tank vapor recovery system, when used with Phase I two-point balance vapor recovery components and Phase II balance vapor recovery components approved by the Air Resources Board for use in certified vapor recovery systems, conforms with all the requirements set forth in Certification Procedure CP-205;

NOW, THEREFORE, IT IS ORDERED that the system is hereby certified to meet the applicable certification performance standards.

IT IS FURTHER ORDERED that the use of Air Resources Board approved Phase I two-point balance system vapor recovery components and Phase II balance system vapor recovery components shall be a condition of the certification. Air Resources Board approved Phase I components are listed in Exhibits 1 through 3 of Executive Order G-70-97-A, Exhibits 1 and 2 of Executive Order G-70-102-A and Exhibits 1 and 2 of Executive Order G-70-142-A. Air Resources Board approved balance system Phase II components are listed in Executive Order G-70-52-AM.

IT IS FURTHER ORDERED that any emergency vent installed on the tank be of the type with a viton seal and be vapor tight at the operating pressure of the tank when tested in accordance with CARB test procedures for determining a vapor leak as defined in the Board's Definitions for Certification Procedures and Test Procedures for Vapor Recovery Systems adopted April 12, 1996, and as last amended March 17, 1999 (the Vapor Recovery Definitions D-200).

IT IS FURTHER ORDERED that the Phase I two-point balance system components and piping configuration used to connect the cargo truck bulk delivery line and the vapor line to the storage tank fill adaptor and vapor recovery adaptor shall be consistent with Air Resources Board Executive Order G-70-97 series, G-70-102 series or G-70-142 series and that remote fill and vapor recovery lines be installed whenever direct fill and vapor recovery connections would require the fuel delivery operator to climb onto the tank to make the connections. Remote connections are not required when the connection points are within reach of the operator or when a suitable access platform and stairs are provided as part of the installation. Such access shall be approved by the Division of Occupational Safety and Health of the Department of Industrial Relations (CalOSHA).

IT IS FURTHER ORDERED that the owner or operator may install a liquid level gauge on the storage tank. Any mechanical liquid level gauge shall be of a type provided with a metal casing or provided with a glass insert if of a type with a plastic gauge top. Electronic liquid level gauges shall be UL listed.

IT IS FURTHER ORDERED that in order to prevent spitback or condensate from blocking the vapor path between the vehicle fill pipe and the storage tank headspace, the routing of the coaxial hose shall be consistent with the configurations shown in Exhibits 4 through 11a in Air Resources Board Executive Order G-70-52-AM. The highest point in the vapor return path must be above the top of the storage tank and

there shall be no liquid trap in the vapor path between the highest point in the vapor return path and the storage tank vapor headspace during fuel dispensing unless a liquid trap and evacuation system are included in the system. There shall be no liquid trap in the vapor path between the vehicle fill pipe and the highest point in the vapor return path during fuel dispensing unless the coaxial hose is equipped with a liquid removal system with the liquid pickup located at the liquid trap.

IT IS FURTHER ORDERED that a P/V valve approved by the Air Resources Board for use in certified vapor recovery systems shall be installed on the tank vent and that the valve have a rated pressure relief setting 3 ± 0.5 inches of water column (wc) gauge and a rated vacuum relief setting of 8 ± 2 inches wc. Any Air Resources Board approved P/V valve meeting the required pressure/vacuum settings may be installed. The installed P/V valve shall extend to a minimum height of 12 feet above the surface from which Phase I fuel delivery is performed.

IT IS FURTHER ORDERED that the general exterior of the storage tank may be painted desert sand epoxy, white or off-white (with any color base) provided the light reflective value (LRV) of the paint is 59 percent or better. All exposed Phase I and Phase II piping shall be painted desert sand epoxy, white or off-white (with any color base) provided the LRV of the paint is 59 percent or better. Light reflective value shall be determined by visual comparison of the paint with the Sherman Williams Industrial Maintenance Coatings Color Sheet. Alternatively, the tank exterior and all exposed Phase I and Phase II piping may be painted white or off white (with any color base) provided the reflectivity of the paint is 75% or better as determined by visual comparison of the paint with paint color cards obtained from a paint manufacturer who uses the "Master Pallet Notation" to specify the paint color (i.e. 58YY 88/180 where the number in italics is the paint reflectivity). The appropriate color card shall be available at the facility for service station type operations or at a central location for remote or unattended locations.

IT IS FURTHER ORDERED that a minimum of four (4) inches of proprietary insulating material be installed between the inner holding tank and exterior containment tank for all configurations of the storage tanks shown in Exhibit 1 and Exhibit 2.

IT IS FURTHER ORDERED that the complete system shall pass a static pressure decay test at least once in each 12-month period. The test shall be performed in accordance with the Board's "Determination of Static Pressure Performance of Vapor Recovery Systems of Dispensing Facilities with Above-Ground Storage Tanks", adopted April 12, 1996 ("Vapor Recovery Test Procedure TP-201.3B," incorporated by reference into title 17, California Code of Regulations, section 94011). The test results shall be reported in a format specified by the local district.

IT IS FURTHER ORDERED that the tank sizes approved by this order shall be from 250 gallons to 12,000 gallons for total capacity of single and split product tanks for gasoline only and total gasoline compartment capacity of split product tanks for gasoline and non-gasoline products.

IT IS FURTHER ORDERED that the installation of the tank and associated piping and other equipment not specifically listed as Phase I equipment approved by the Air Resources Board for use in certified vapor recovery systems in CARB executive orders shall comply with the requirements of local fire officials with jurisdiction where the system is installed.

IT IS FURTHER ORDERED that compliance with the rules and regulations of the local air pollution control district with jurisdiction over the location where the system is installed shall be made a condition of this certification.


IT IS FURTHER ORDERED that compliance with all applicable certification requirements and rules and regulations of the Division of Measurement Standards, the Office of the State Fire Marshall, and the Division of Occupational Safety and Health of the Department of Industrial Relations shall be made a condition of this certification.

IT IS FURTHER ORDERED that any alteration of the equipment, parts design, or operation of the systems certified hereby is prohibited unless such alteration has been approved by the Executive Officer or his or her designee. Any unapproved alteration shall void the certification for the specific installation where such alteration occurred.

Executed at Sacramento, California this 11 th day of May 2000.

/Signed/
James J. Morgester, Chief
Compliance Division


Exhibit 1
Executive Order G-70-194
Containment Solutions Incorporated "Hoover Vault" Top Mount
Rectangular and Cylindrical Aboveground Tank Vapor Recovery System

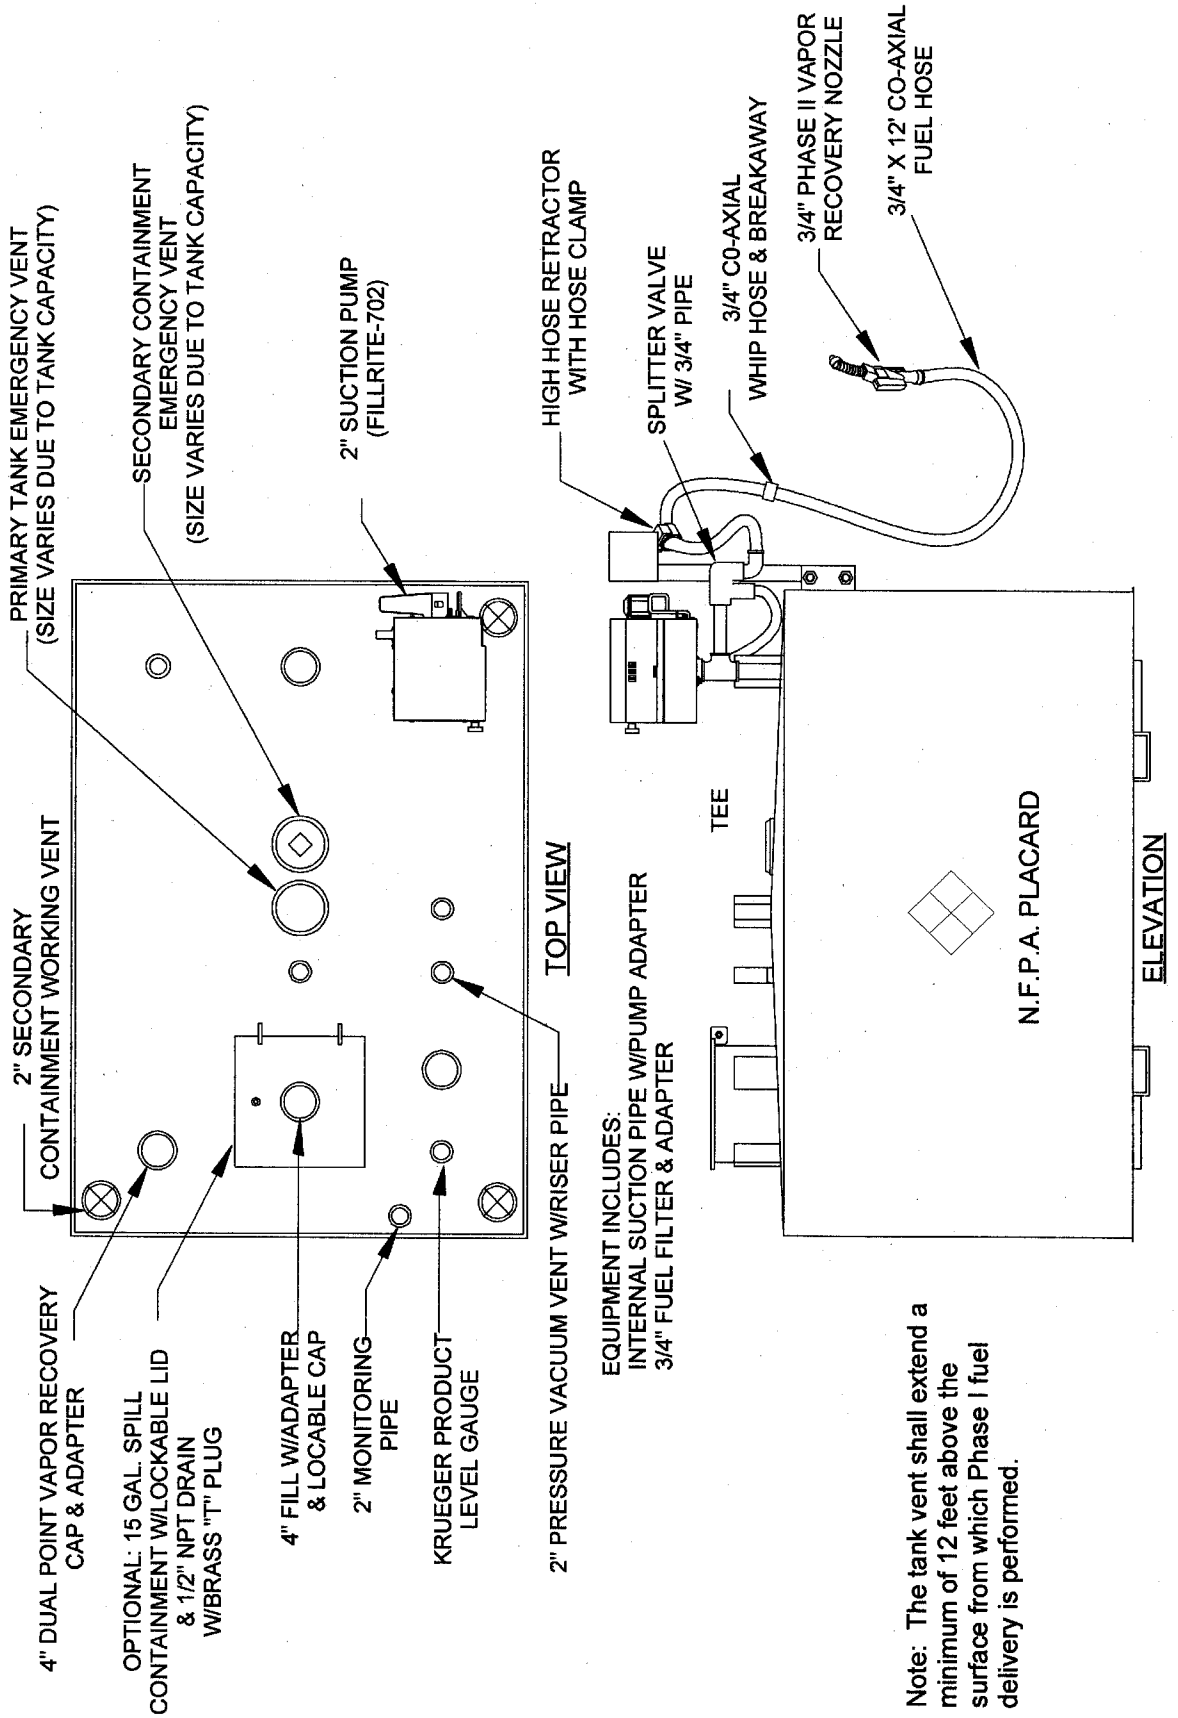

Note: The tank vent shall extend a minimum of 12 feet above the surface from which Phase I fuel delivery is performed.

Exhibit 2
Executive Order G-70-194
Containment Solutions Incorporated "Hoover Vault" Side Mount
Rectangular and Cylindrical Aboveground Tank Vapor Recovery System

- NOTES:**
1. 4" FILL W/ ADAPTER & LOCKABLE CAP
 2. 4" DUAL POINT VAPOR RECOVERY CAP & ADAPTER
 3. PRODUCT LEVEL GAUGE
 4. PRIMARY EMERGENCY VENT (SIZE VARIES DUE TO TANK CAPACITY)
 5. SECONDARY EMERGENCY VENT (SIZE VARIES DUE TO TANK CAPACITY)
 6. WORKING VENT PRIMARY
 7. WORKING VENT SECONDARY
 8. 2" PUMP
 9. 4" INSULATION PORT

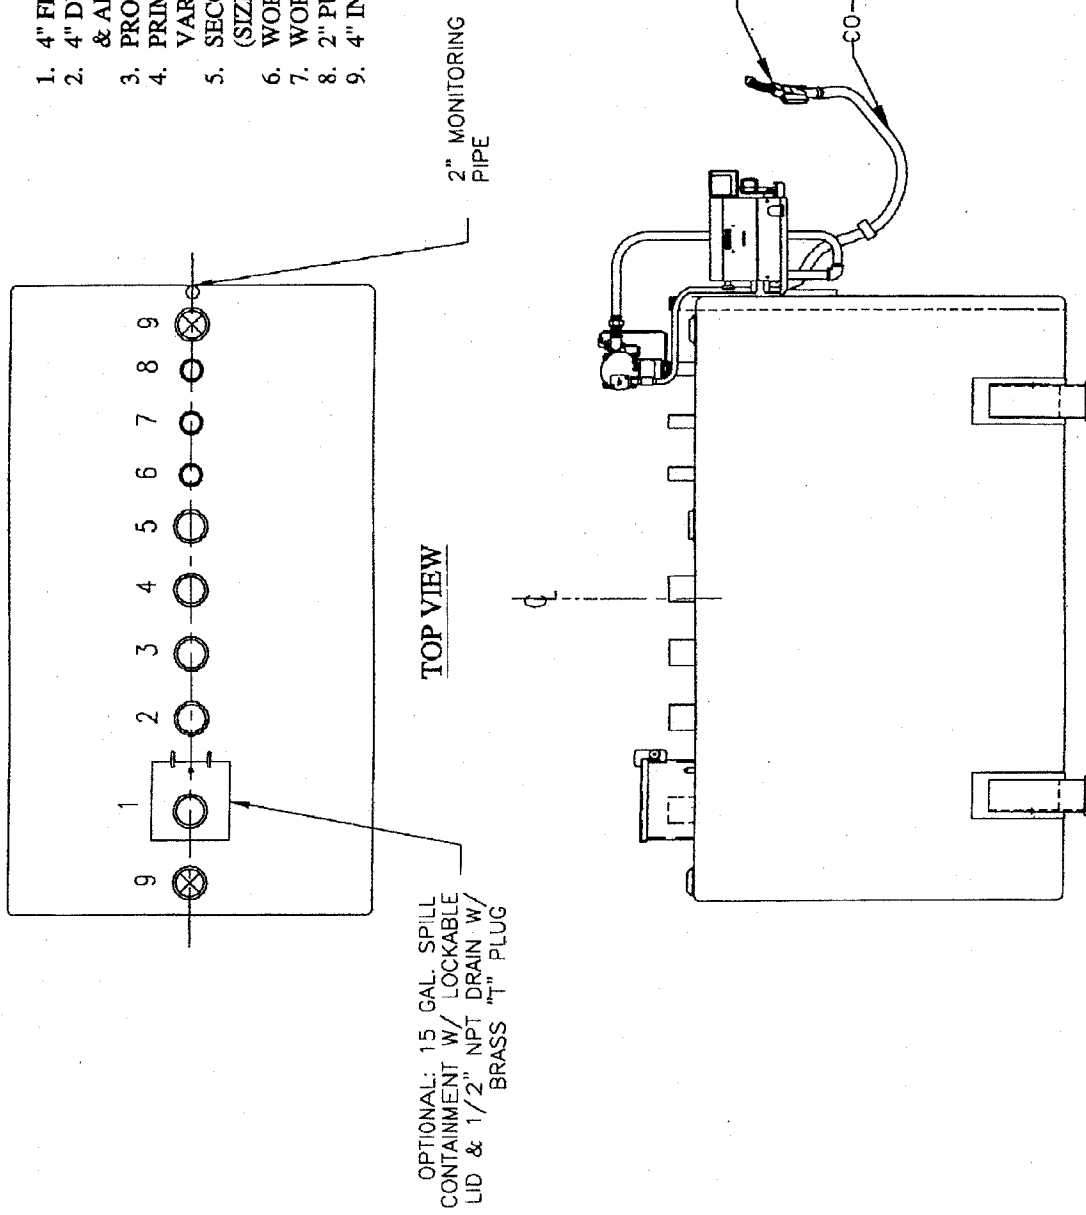

OPTIONAL: 15 GAL. SPILL CONTAINMENT W/ LOCKABLE LID & 1/2" NPT DRAIN W/ BRASS "T" PLUG

Note: The tank vent shall extend a minimum of 12 feet above the surface from which Phase I fuel delivery is performed.