

California Environmental Protection Agency



**Vapor Recovery Test Procedure**

**PROPOSED: TP-201.2F**

**Pressure-Related Fugitive Emissions**

**Adopted: \_\_\_\_\_**

All text is proposed for adoption.

California Environmental Protection Agency  
Air Resources Board

Vapor Recovery Test Procedure

DRAFT TP-201.2F

Pressure-Related Fugitive Emissions

Definitions common to all certification and test procedures are in:

**D-200 Definitions for Vapor Recovery Procedures**

For the purpose of this procedure, the term "CARB" refers to the State of California Air Resources Board, and the term "Executive Officer" refers to the CARB Executive Officer, or his or her authorized representative or designate.

**1. PURPOSE AND APPLICABILITY**

- 1.1 The purpose of this test procedure is to quantify the mass of organic compounds emitted from pressure-related fugitive leak sources. It is applicable when a positive gauge pressure is exerted on the vapor containment space of the underground storage tank (UST).

**2. PRINCIPLE AND SUMMARY OF TEST PROCEDURE**

- 2.1 The volumetric leak rate from pressure-related fugitive leak sources is determined using the results from *modified* CARB Test Procedure TP-201.3, "*Determination of 2 Inch WC Static Pressure Performance of Vapor Recovery Systems of Dispensing Facilities*". The actual gauge pressure in the vapor containment space of the UST is monitored and the hydrocarbon concentration of the gasoline vapors at the fugitive leak sources is also measured, or a default saturated concentration is assumed. The mass of the pressure-related fugitive emissions is calculated using the volumetric leak rate from a pressure decay test, the actual monitored pressure, and the hydrocarbon concentration of the gasoline vapor.

- 2.2 The modifications to CARB Test Procedure TP-201.3 contained in this procedure are as follows:

2.2.1 The minimum and maximum allowable combined ullages are 2,000 and 15,000 gallons.

2.2.2 For all Phase II system types, product dispensing shall not occur during the thirty minutes immediately prior to the test.

**3. BIASES AND INTERFERENCES**

- 3.1 The location(s) chosen to measure the hydrocarbon concentration may not represent the hydrocarbon concentration that is emitted at every potential fugitive leak point in the vapor system.
- 3.2 If the default hydrocarbon concentration is used, the calculated pressure-related fugitive emissions may be higher than the actual emissions.
- 3.3 Systems with a negative gauge pressure in the vapor containment space of the UST prior to conducting the pressure decay portion of this procedure will be biased toward lower fugitive leakrates if air is allowed to bring the system from negative gauge to zero gauge pressure. This bias will be minimized if nitrogen is used to bring the pressure from negative gauge to zero gauge pressure.

#### **4. SENSITIVITY, RANGE, AND PRECISION**

- 4.1 The full-scale range of the electronic pressure measuring device used during the pressure decay portion of the procedure shall not exceed 10 inches H<sub>2</sub>O with a minimum accuracy of 0.5 percent of full-scale. A 20 inches H<sub>2</sub>O full-scale device may be used, provided the equivalent accuracy is not less than 0.25 percent of full scale.
- 4.2 During the pressure decay portion of the procedure, the minimum and maximum total ullages shall be 2,000 and 15,000 gallons, respectively. These volumes are exclusive of all vapor piping volumes.
- 4.3 During the pressure decay portion of the procedure, the minimum and maximum nitrogen feed-rates into the system shall be one (1.0) and five (5.0) CFM, respectively.
- 4.4 The Flame Ionization Detector specified in Section 5.7 shall be capable of accurately measuring hydrocarbon concentrations between 15 and 45 percent, as C<sub>4</sub> (20 to 60 percent as C<sub>3</sub>).
- 4.5 The pressure transducer used to continuously monitor the pressure in the UST vapor containment space shall be accurate to within 0.05 inches H<sub>2</sub>O
- 4.6 The datalogger used to record the UST vapor containment space pressure shall be capable of recording data points at a minimum frequency of five seconds.


#### **5. EQUIPMENT**

- 5.1 Nitrogen. Use commercial grade gaseous nitrogen in a high pressure cylinder, equipped with a two-stage pressure regulator and a one psig pressure relief valve.
- 5.2 Electronic Pressure Measuring Device. Use an electronic pressuring measuring device with a maximum fullscale range of 10 inches H<sub>2</sub>O and a minimum accuracy of 0.5 percent to monitor the pressure decay in the vapor recovery system during the pressure decay portion of the procedure. The pressure

measuring device shall, at a minimum, be readable to the nearest 0.01 inches H<sub>2</sub>O.

- 5.3** "T" Connector Assembly. See Figure 1 for example. This component is used if the pressure decay portion of the procedure is conducted at a Phase II vapor riser.

**Figure 1**  
**"T" Connector Assembly**

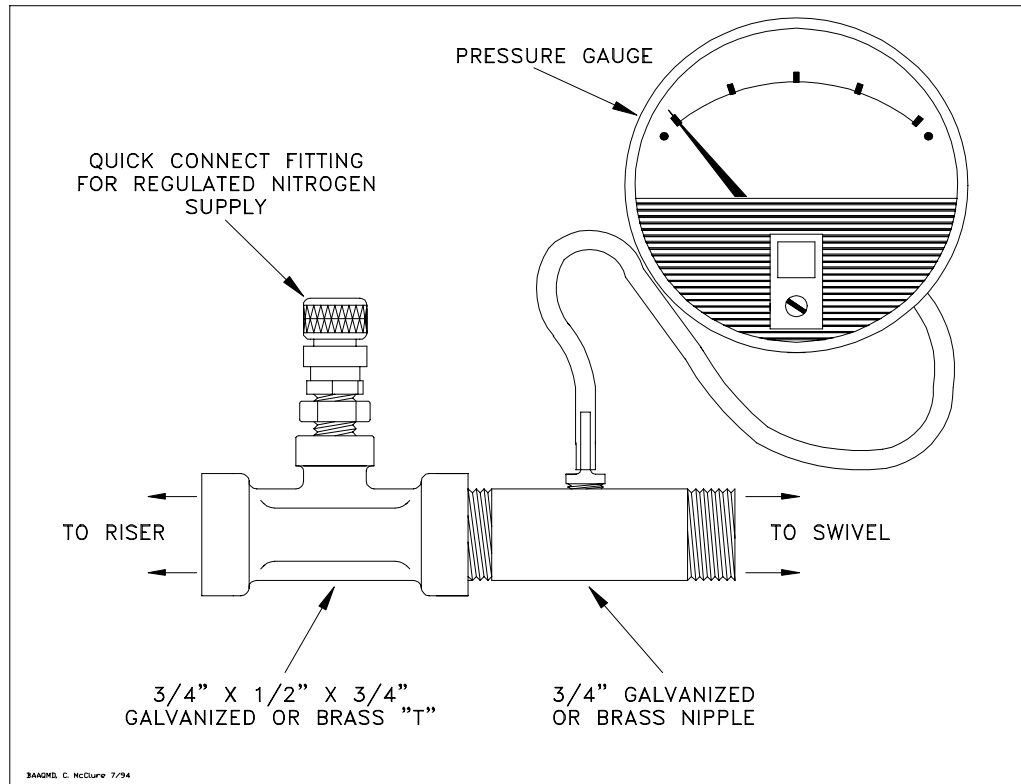

- 5.4** Vapor Coupler Test Assembly. If the pressure decay portion of the procedure is conducted at a Phase I vapor coupler, use a compatible cap, equipped with a center probe to open the poppet and a pressure measuring device to monitor the pressure decay in the vapor containment space of the UST. The Vapor Coupler Test Assembly shall include a connection for the introduction of nitrogen into the system. See Figure 2 for an example.

- 5.5** Stopwatch. Use a stopwatch accurate to within 0.2 seconds.


- 5.6** Flowmeter. Use a Dwyer flowmeter, Model RMC-104, or equivalent, to determine the required pressure setting of the delivery pressure gauge on the nitrogen supply pressure regulator. This pressure shall be set such that the nitrogen flowrate is between 1.0 and 5.0 CFM.

- 5.7** Flame Ionization Detector (FID). Use a Flame Ionization Detector to continuously monitor the hydrocarbon concentration of the containment space of the UST. The

FID shall be calibrated using either propane or butane. Appropriate methodology shall be employed to permit the determination of both methane and Non-Methane Organic Carbon (NMOC) concentrations.

- 5.8** Pressure Transducer and Electronic Data Recording Device. Use a pressure transducer accurate to within 0.05 inches H<sub>2</sub>O to continuously monitor the pressure in the UST vapor containment space. The data shall be continuously recorded using either a datalogger or strip chart recorder. The datalogger shall be capable of recording data points at a minimum frequency of five seconds.

**Figure 2**  
**Vapor Coupler Test Assembly**

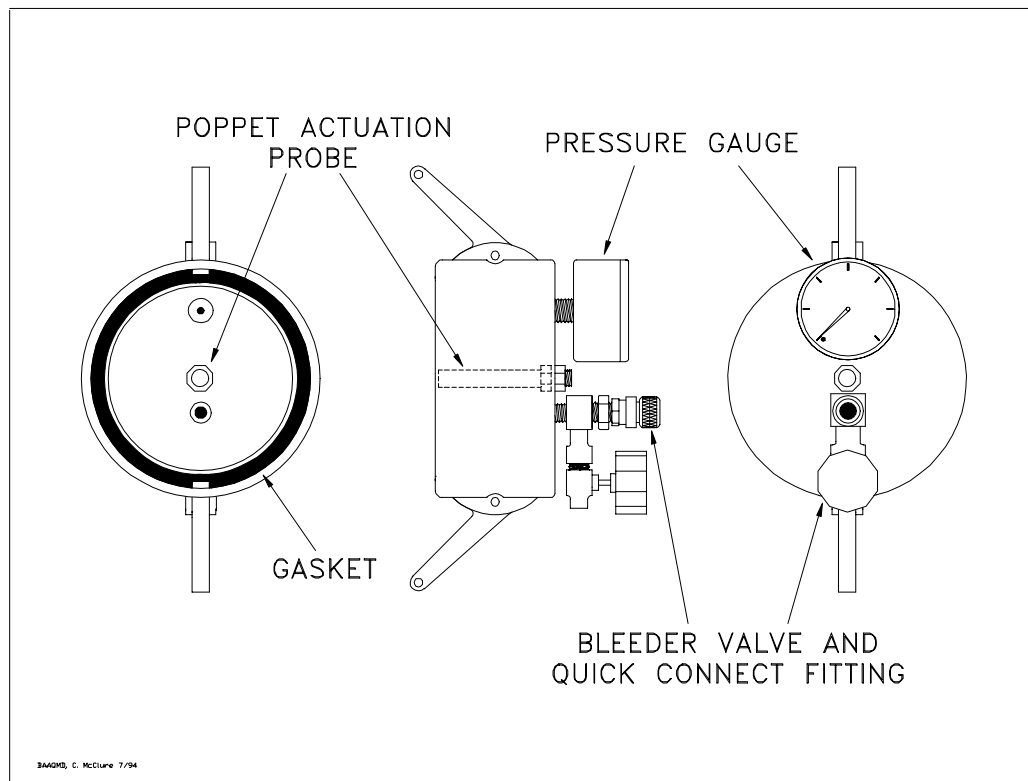

## 6. PRE-TEST PROCEDURES

- 6.1** The following requirements shall be adhered to in all cases:

- 6.1.1 Only gaseous nitrogen shall be used to pressurize the system during the pressure decay portion of the procedure.
- 6.1.2 A one psig relief valve shall be installed on the nitrogen tank to prevent the possible over-pressurizing of the storage tank.
- 6.1.3 A ground strap shall be employed during the introduction of nitrogen into the system during the pressure decay portion of the procedure.

- 6.2** Product dispensing shall not occur during the pressure decay portion of the test. There shall have been no Phase I deliveries into or out of the UST storage tanks within the three hours immediately prior to the test. Product dispensing shall not occur during the thirty minutes immediately prior to the test.
- 6.3** Measure the gallons of gasoline present in each underground storage tank and determine the actual capacity of each storage tank from facility records. Calculate the ullage space for each tank by subtracting the gasoline gallonage present from the actual tank capacity. The minimum ullage during the test shall be 25 percent of the tank capacity or 500 gallons, whichever is greater. The total ullage shall not exceed 15,000 gallons.
- 6.4** For two-point Phase I systems, the CARB TP-201.3 procedure shall be conducted with the cap removed from all Phase I vapor couplers. This is necessary to determine the vapor tightness of the Phase I vapor poppet.
- 6.4.1 For coaxial Phase I systems, this test shall be conducted with the cap removed from the Phase I coupler. This is necessary to insure the vapor tightness of the Phase I vapor poppet.
- 6.4.2 Verify that the liquid level in the storage tank is at least four (4) inches above the highest opening at the bottom of the submerged drop tube.
- 6.5** The pressure decay portion of the procedure shall be conducted with the Phase I containment box drain valve(s) (if applicable) installed and the manhole cover removed.
- 6.6** If the pressure decay portion of the procedure is to be conducted at a Phase II vapor riser, disconnect the dispenser end of one vapor recovery hose and install the "T" connector assembly (see Figure 30-1). Connect the nitrogen gas supply (do not use air) and the pressure measuring device to the "T" connector.
- 6.7** All pressure measuring device(s) shall be bench calibrated using either a reference gauge or incline manometer. Calibrations shall be performed at 20, 50, and 80 percent of full scale. Accuracy shall be within 0.5 percent at each of these calibration points. Calibrations shall be conducted on a frequency not to exceed 180 days.
- 6.8** Use the flowmeter to determine the correlation between the nitrogen regulator delivery pressures and nitrogen flowrates of 1.0 and 5.0 CFM. These pressures define the allowable range of delivery pressures acceptable for the pressure decay portion of the test procedure. Also record the regulator delivery pressure setting, and the corresponding nitrogen flowrate that will be used during the test. As an alternative, the flowmeter may be connected, in-line between the nitrogen supply regulator and Vapor Coupler Test Assembly, during the test.
- 6.9** Use Equation 9.4 to calculate the approximate time required to pressurize the system ullage to the initial starting pressure of two (2.0) inches H<sub>2</sub>O. This will

allow the tester to minimize the quantity of nitrogen introduced into those systems containing leaks large enough to prevent the system from achieving the initial pressure of two (2.0) inches H<sub>2</sub>O.

## 7. TEST PROCEDURE

**7.1** Use the FID hydrocarbon analyzer to continuously monitor the hydrocarbon concentration at either the top of the UST, using the Phase I vapor connector, for a minimum of sixty (60) minutes, or as specified by CARB, prior to conducting the pressure decay portion of the procedure. Continuous sampling shall be conducted in accordance with USEPA Method 25A. EPA Method 18 may be used to determine the hydrocarbon concentration, provided the collected sample is integrated over a period not less than 60 minutes, or as specified by CARB. The sampling shall not be conducted during the pressure decay portion of the procedure is being conducted.

**7.1.1** In lieu of measuring the vapor hydrocarbon concentration, the vapor hydrocarbon concentration of the gasoline vapor can be assumed to be 38 percent, as C<sub>4</sub> (50 percent as C<sub>3</sub>). This assumed-value approach may only be employed with the prior approval of the California Air Resources Board.

**7.2** Attach the Vapor Coupler Test Assembly to the Phase I poppet or the "T" connector assembly to the Phase II vapor riser. Read the initial pressure of the storage tank and underground piping. If the initial pressure is greater than 0.5 inches H<sub>2</sub>O, carefully bleed off the pressure, in accordance with all applicable safety procedures, from the vapor containment space of the UST to less than 0.5 inches H<sub>2</sub>O.

**7.3** Open the nitrogen gas supply valve and set the regulator delivery pressure within the allowable range determined in Section 6.8, and start the stopwatch. Pressurize the vapor system (or subsystem for individual vapor return line systems) to **at least 2.2 inches H<sub>2</sub>O** initial pressure. It is critical to maintain the nitrogen flow until the pressure stabilizes, indicating temperature and vapor pressure stabilization in the tanks. Check the test equipment using leak detecting solution or a combustible gas detector to verify that all test equipment is leak tight.

**7.3.1** Use the results of Equation 9.4 to determine if the system leaks exceed the nitrogen feed rate.

**7.4** Close and disconnect the nitrogen supply. Start the stopwatch when the pressure has decreased to the initial starting pressure of 2.0 inches H<sub>2</sub>O.

**7.5** At one-minute intervals during the test, record the system pressure. After five minutes, stop the stopwatch and record the final system pressure.

**7.6** If the vapor recovery system utilizes individual vapor return lines and the vapor containment space of the USTs are not manifolded, repeat the pressure decay portion of the procedure for each UST. Avoid leaving any vapor return line open longer than is necessary to install or remove the "T" connector assembly.

7.7 Use the pressure transducer and electronic data recording device to continuously monitor the pressure in the UST vapor containment space. Record the total number of gallons dispensed during the time that pressure data is being collected.

## **8. POST-TEST PROCEDURES**

8.1 After the pressure decay portion of the procedure has been completed, and after the remaining system pressure has been relieved, remove the "T" connector assembly and reconnect the vapor recovery hose or remove the vapor coupler test assembly from the Phase I vapor coupler, as applicable.

8.2 Use Equations 9.1 to calculate the pressure-related fugitive flowrate.

8.3 Use Equation 9.2 to calculate the mass emission rate of pressure-related fugitives.

8.4 Use Equation 9.3 to calculate the mass emission factor of pressure-related fugitive emissions.

8.5 Reduce the data to tabulate the duration of each positive gauge pressure, or pressure range, as shown in Form 1. If the UST pressure data is reduced as pressure ranges, each range shall not exceed 0.25 inches H<sub>2</sub>O, and the midpoint of each range shall be used to calculate the pressure-related fugitive flowrates. Report all data shown in Form 1.



## 9. CALCULATING RESULTS

9.1 The pressure-related fugitive flowrate shall be calculated as follows:

$$Q = (60) \left[ \frac{(V)(2.00 - P_f)}{(5)(7.481)(406.9) \left( 2.00 \left( \frac{P_f}{2.00} \right)^{1/2} \right)^{1/2}} \right] (P_{act})^{1/2} \quad \text{Equation 9.1}$$

where:

- $Q$  = Pressure-related fugitive flowrate, cubic feet per hour (ft<sup>3</sup>/hour)
- $V$  = Total ullage affected by the test, gallons
- $P_{act}$  = Actual pressure measured in UST containment space, inches H<sub>2</sub>O
- $P_f$  = Final gauge pressure from pressure decay test portion of test, inches H<sub>2</sub>O
- 60 = Conversion factor for minutes to hours, minutes/hour
- 2.00 = Initial gauge pressure from pressure decay portion of test, inches H<sub>2</sub>O
- 5 = Five minutes
- 7.481 = Conversion factor for gallons to cubic feet, gallons/ft<sup>3</sup>
- 406.9 = Atmospheric pressure, inches H<sub>2</sub>O

9.2 The mass emission rate of pressure-related fugitive emissions shall be calculated as follows:

$$M = \left[ \frac{(Q)(C)(MW)}{(386.9)(100)} \right] \quad \text{Equation 9.2}$$

where:

- $M$  = Mass rate of fugitive emissions, lb/hour
- $C$  = Hydrocarbon concentration, percent (C<sub>3</sub> or C<sub>4</sub>)
- $MW$  = Molecular weight, lb/lb-mole [44.096 for C<sub>3</sub> or 58.123 for C<sub>4</sub>]
- 386.9 = Molar volume, ft<sup>3</sup>/lb-mole
- 100 = Conversion factor for percent to mole fraction

**9.3** The mass emission factor for pressure-related fugitive emissions shall be calculated as follows:

$$E_{PRF} = \left[ \frac{(M)(t_{act})(1,000)}{(G_{act})} \right] \quad \text{Equation 9.3}$$

Where:

- $E_{PRF}$  = Emission factor for pressure-related fugitives, lb/1,000 gallons
- $t_{act}$  = Duration of the test, hours
- $G_{act}$  = Gallons dispensed during the test, gallons
- 1000 = Conversion factor, dimensionless

**9.4** The minimum time required to pressurize the system ullage from zero (0) to an initial pressure of 2.00 inches H<sub>2</sub>O shall be calculated as follows:

$$t_{Pi} = \left[ \frac{V \left( \left( \frac{406.9 + 2.00}{406.9} \right)^{-1} \right)}{(7.481)(Q_N)} \right] \quad \text{Equation 9.4}$$

Where:

- $t_{Pi}$  = Minimum time to pressurize the ullage to 2.00 inches H<sub>2</sub>O, minutes
- $V$  = Total ullage affected by the test, gallons
- 2.00 = Initial starting pressure for the test, inches H<sub>2</sub>O
- $Q_N$  = Nitrogen flowrate into the system, CFM
- 7.481 = Conversion factor for gallons to cubic feet, gallons/ft<sup>3</sup>

**9.5** A sample calculation is shown in Appendix 1.

## **10. REPORTING RESULTS**

**10.1** Report the results of the test as shown in Form 1.

## **11. Appendix 1**

An example calculation, demonstrating the method of determining pressure-related fugitive emissions based on the leak decay rate, the hydrocarbon concentration, and

the measured pressure, is shown below:

**Given:**

**Pressure Decay Portion of Procedure**

Ullage	10,000
Initial Pressure, inches H <sub>2</sub> O	2.00
Final Five-Minute Pressure, inches H <sub>2</sub> O	1.88
Atmospheric Pressure, inches H <sub>2</sub> O	406.9

**Hydrocarbon Measurement Portion of Test**

Hydrocarbon Concentration, % as C <sub>3</sub>	36.0
--	------

**Pressure Measurement Portion of Test**

Test duration, hours	24.0
Gallons Dispensed during Test, gallons	8,500
<b>Positive Gauge Pressures:</b>	
1.5 inches H <sub>2</sub> O for 4.5 hours	
2.0 inches H <sub>2</sub> O for 7.5 hours	
3.0 inches H <sub>2</sub> O for 5.0 hours	

**Find:** The hydrocarbon pressure-related fugitive emissions leak rate, mass emission rate of pressure-related fugitives, and the mass emission factor of pressure-related fugitives.

Use Equation 9.1, inserting the different values of the actual measured pressures of 1.5, 2.0, and 3.0 inches H<sub>2</sub>O for P<sub>act</sub>.

$$Q = (60 \text{ min/hr}) \left[ \frac{(10,000 \text{ gallons})(2.00 - 1.88)}{(5)(7.481)(406.9) \left( 2.00 \left( \frac{1.88}{2.00} \right)^{1/2} \right)^{1/2}} \right] (P_{act})^{1/2}$$

This results in the following pressure-related fugitive flowrates, in CFM, at the various measured pressures during the 24 hour test period :

- Q<sub>1.5</sub> = 4.161 CFH
- Q<sub>2.0</sub> = 4.804 CFH
- Q<sub>3.0</sub> = 5.884 CFH

The average pressure-related fugitive flowrate, in CFH during the 24 hour test is calculated as follows:

$$Q = \left( \frac{(4.161\text{cfh})(4.5\text{hr}) + (4.804\text{cfh})(7.5\text{hr}) + (5.884\text{cfh})(5.0\text{hr})}{(24\text{hr})} \right)$$

$$Q = \left( \frac{84.175}{24} \right) = 3.507\text{cfh}$$

The average mass emission rate of pressure-related fugitive emissions during the 24 hour test is calculated from Equation 9.2 as follows:

$$M = \left[ \frac{(3.507\text{cfh})(36\%)(44.096\text{lb / lb - mole})}{(386.9\text{ft}^3 / \text{lb - mole})(100\%)} \right] = 0.144\text{pounds / hour}$$

The mass emission factor for pressure-related fugitive emissions is calculated from Equation 9.3 as follows:

$$E_{\text{prf}} = \left[ \frac{(0.144\text{lb / hr})(24\text{hr})(1,000)}{8,500\text{gal}} \right] = 0.406\text{lb / 1,000gal}$$

# Form 1

## TP-201.2F Reporting Form

### Summary of Pressure-Related Fugitive Emissions

GDF Name _____	Phase II System Type _____
GDF Address _____	Phase I Type _____
City _____	Total # of Dispensers _____
Telephone # _____	Total # of Nozzles _____

#### TP-201.2F Results

#### 2 Inch H<sub>2</sub>O Pressure Decay Results

Test Date: _____				<b>Initial Pressure, P<sub>i</sub> = 2.00 inches H<sub>2</sub>O</b>  + 1 Minute _____ inches H <sub>2</sub> O + 2 Minutes _____ inches H <sub>2</sub> O + 3 Minutes _____ inches H <sub>2</sub> O + 4 Minutes _____ inches H <sub>2</sub> O + 5 Minutes (P <sub>f</sub> ) _____ inches H <sub>2</sub> O	
	Tank 1 Grade _____	Tank 2 Grade _____	Tank 3 Grade _____		
Capacity, gal					
Gallonage, gal					
Ullage					
Total Ullage, gal					

#### Hydrocarbon Measurement Results

Calibration Gas, propane or butane _____	Hydrocarbon Concentration, % _____
Method, FID, Method 18, Other _____	Duration of Sampling, hours _____

#### Pressure Measurement and Throughput Results

Test Dates and Times Start Date _____ Start Time _____ End Date _____ End Time _____	Duration of Pressure Measurements _____ hours Total Hours of Positive Gauge Pressure _____ hours Total Throughput During Test, _____ gallons
--	--

Pressure Range, inches H <sub>2</sub> O	Duration in Range, Hours	Arithmetic Midpoint of Pressure Ranges	Pressure-Related Fugitive Flowrate, CFH [From Equation 9.1]
<b>TOTALS</b>			