


# Executive Order G-70-175

## Figure 2B-3 Control Panel

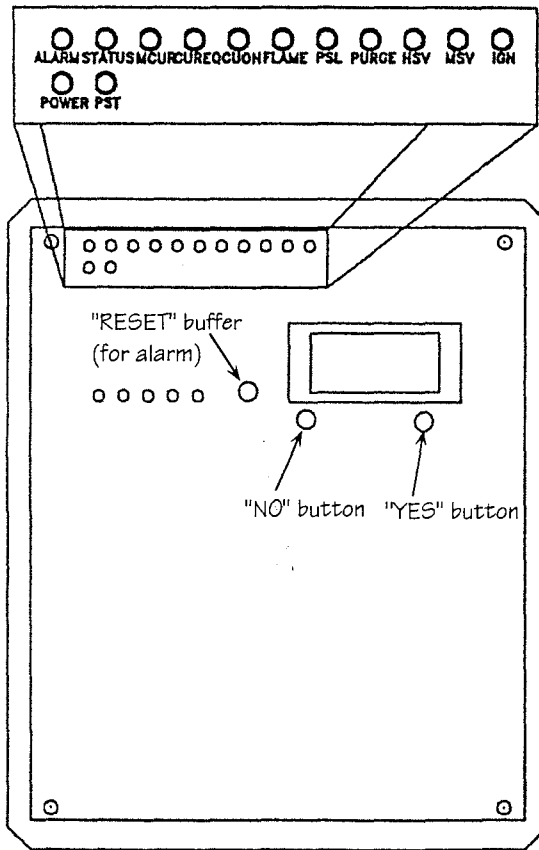

### Key to LEDs:

- ALARM => Alarm Condition
- CUON => Collection Unit Active
- CUREQ => Dispenser Active
- FLAME => Processing Vapors
- HSV => High Volume Processing
- IGN => Initiate Processing
- MCUR => Collection Unit Sensor
- MSV => Main Processor Valve Open
- POWER => Panel Power
- PSL => Processor Pressure
- PST => Tank Ullage Pressure
- PURGE => Clearing Lines
- STATUS => Not Used